




BIOX[®]

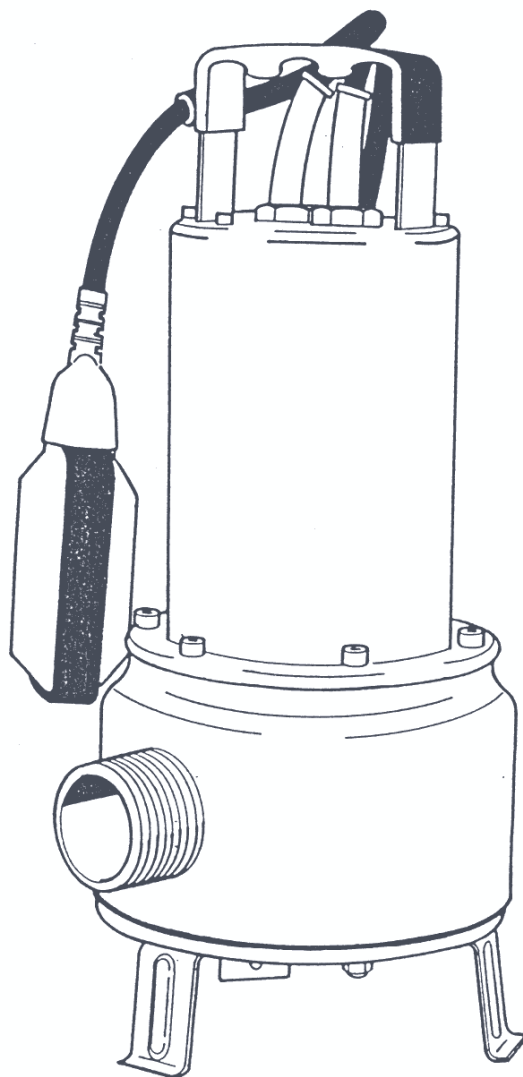

- I** manuale uso e manutenzione
- GB** instructions for use and maintenance
- F** mode d'emploi et norme d'entretien
- D** instandhaltung und betriebsanleitung

Dichiarazione CE di Conformità

La Ditta NOCCHI POMPE S.p.A. dichiara sotto la propria responsabilità che i prodotti della serie:
BIOX sono conformi ai Requisiti Essenziali di Sicurezza e di Tutela della Salute di cui alla Direttiva CEE 73/23 e sue successive modifiche,

DECLARATION OF CONFORMITY TO STANDARDS

The Company NOCCHI POMPE S.p.A. declares, under its own responsibility, that the products of the series:
BIOX conform with Health and Safety standards, specified by EC directive 73/23 and subsequent amendments.

Declaration CE de Conformité

La société NOCCHI POMPE S.p.A. déclare sous sa propre responsabilité que les produits des séries:
BIOX sont conformes aux conditions essentielles de sécurité et de tutelle de la santé dont à la directive CEE 73/23 et modifications.

KONFORMITÄTSEKRLÄRUNG

Die unterzeichnete Firma NOCCHI POMPE S.p.A. erklärt unter eigener Verantwortung, daß die Produkte der Serien:
BIOX den wesentlichen Sicherheits- und gesundheitlichen Anforderungen der EG-Richtlinie 73/23 und nachfolgenden Änderungen entsprechen.

Declaración CE de Conformidad

La Empresa suscrita NOCCHI POMPE S.p.A. declara bajo su propia responsabilidad que los productos de la serie:
BIOX cumplen con los requisitos esenciales de seguridad y de tutela de la salud de la Directiva CEE 73/23 y sus posteriores modificaciones.

CONFORMITEITSVERKLARING

De ondertekenende firma NOCCHI POMPE S.p.A. Verklaart onder eigen verantwoording de producten van de serie's:
BIOX voldoen aan de Essentiële Eisen met betrekking tot de Veiligheid en de Gezondheid vermeld in de EEG-richtlijn 73/23 en de successievelijke wijzigingen hiervan is.

EU-VAATIMUSTENMUKAISUUSVAKUUTUS

Yhtiö NOCCHI POMPE S.p.A. ilmoittaa omalla vastuullaan, että tuotteet, jotka kuuluvat sarjaan:
BIOX noudattavat EU-direktiivin 73/23 ja siihen tehtyjen muutosten määräitelmää terveys- ja turvallisuusnormeja.

EF-OVERENSSTEMMELSESERKLÆRING

Undertegnede firma NOCCHI POMPE S.p.A. erklærer hermed under ansvar, at produktene i seriene:
BIOX er fremstillet i overensstemmelse med de Væsentlige Sundheds- og Sikkerhedskrav, der er anført i EF-direktiv 73/23/EØF med efterfølgende ændringer.

Declaração de Conformidade CE

A empresa abaixo NOCCHI POMPE S.p.A. Declara sob a própria responsabilidade que os produtos das séries:
BIOX estão em conformidade com os Requisitos Essenciais de Segurança e Tutela da Saúde contidos na Directiva CEE 73/23 e sucessivas modificações.

DEKLARATION OM ÖVERENSSTÄMMELSE MED STANDARD

Företaget NOCCHI POMPE S.p.A. deklarerar under eget ansvar eget att seriens produkter:
BIOX överensstämmer med de hälso- och skyddsnormer som specificeras i EU-direktiv 73/23 och sehare tillägg jämte.

YFIRLYSING UM ÁDLÖGUN AD STÖDLUM

Fyrirtækið NOCCHI POMPE S.p.A. lýsir því yfir, á elgin ábyrgð, að framleiðsluvara í þessum flokki véla:
BIOX er í samræmi við staðla um heilsu og öryggi sem settir eru fram með tilskipun Evrópusambandsins 73/23 og samræmist að auki kröfum setlum.

ERKLÆRING OM SAMSVAR MED STANDARDER

Firmaet NOCCHI POMPE S.p.A. erklærer, under eget ansvar, at produktene i serien:
BIOX samsvarer med helse- og sikkerhetsstandarder som er fastsatt i EF-direktiv 73/23 og senere endringer.



Rainbow Pool Products

PO Box 2388, Mansfield Qld 4122

Telephone STD 61-7-3849 5385

Facsimile STD 61-7-3849 5384

Email: info@rainbowpoolproducts.com.au

Web: www.rainbowpoolproducts.com.au

INDEX

- Cap.1- Features
- Cap.2- Use and his limitations
- Cap.3- Installation
- Cap.4- Electric connections
- Cap.5- Maintenance and trouble shooting

Notice for safety.
Please give particular care to following signs.



DANGER
Electric shock risk

Improper use may lead into electric shock.



DANGER

Improper use may lead into heavy risk for persons and things.



REMARK

Improper use may cause damage to pump or installation.

ATTENTION: Before installing the pump please carefully read this manual. Guarantee will not be activated in case of improper use.

CHAP.1 FEATURES

BIOX® range pumps are particularly suitable to remove dirty water with suspended solids.

BIOX® pumps are well sized and can be possibly utilized both in fixed or movable installations.

BIOX® pumps are used to transfer dirty water, waste water and sewage water.

Each pump is tested and packed very attentively.

Please ensure pump has not been damaged during transport; if this occurs please phone the dealer, within 8 days from purchasing day.

CHAP. 2 USE AND HIS LIMITATIONS



REMARK

Pump cannot be used to move inflammable or dangerous liquids.



REMARK

Ensure pump never runs dry

<u>MAX. TEMP. OF LIQUID:</u>	50°C in continuous service to motor completely submerged.
<u>MAX. IMMERSION HEIGHT:</u>	7 m with 10 mt. of power cord
<u>MAX. FREE PASSAGE:</u>	40 mm
<u>MAX. ON/OFF CYCLES/HOUR:</u>	30 equally spaced

The performance data are in millimeters

Please refer to Pict. 1

TYPE	MIN. PRIMING LEVEL	MIN. DRAINAGE LEVEL	START LEVEL	STOP LEVEL	WEIGHT Kg.
Picture	A	B	C	D	
BIOX® 200/8	123mm	45mm	370mm	250mm	8,5
BIOX® 300/10	123mm	45mm	400mm	300mm	9
BIOX® 400/12	123mm	45mm	400mm	300mm	10

Pump with less than 10 mt. supply cord cannot be used in open spaces.
The min. priming level refers to completely submerged outlet. (See Pict. 1)

CHAP. 3 INSTALLATION



DANGER
Electric shock risk

When installing, please ensure pump is disconnected from electric current network.

Please use handlebar to remove or lift pump up.

Please use a non-return valve in case pump is connected to fixed installation with rigid piping; this will avoid liquid circulating when pump has been turned off; use of a pipe fitting will allow easy disconnection of pump for maintenance.

Dimensions of drain well must allow max. 30 on/off cycles/hour. (See USE AND HIS LIMITATIONS)

Please use flexible pipe connected to pump by means of plastic fitting in case of temporary use of pump.

Use a rope to immerse pump and fasten it to pump's handlebar.

BIOX® aut is equipped with a pre-rated float switch (See Pict. 1); please increase or decrease the free piece of float switch cable by making it sliding through the proper seat on the handlebar, when modifying the rating of float switch.

Pumps used besides or inside swimming pools, garden ponds or similar places may have special requirements.



REMARK

Make sure that float switch turns off pump, when at min. level of liquid.



REMARK

Make sure no obstacles stand in the way of float switch, during up/down swinging.

CHAP. 4 ELECTRIC CONNECTION



REMARK

Ensure tension and frequency of pump (read motor plate) and supply network are same.



DANGER
Electric shock risk

Installer must make sure that electric current network has ground wire conforming to current laws.



DANGER
Electric shock risk

Make sure that electric current network is provided with a high-sensitivity circuit-breaker
 $\Delta=30$ mA (DIN VDE 0100T739)

Single phase version

Single phase pumps are equipped with double ground contact plug at top end of supply cord ; in this case grounding is done when plugging in.

Three phase version

In this case the ground wire (yellow-green cable) of supply cord must be connected to ground wire of electric current network.

Ensure connection to electric current network by using an omnipolar-sectionned magneto thermic circuit-breaker.

This will ensure effective disconnection from electric current network.

BIOX® range pumps have a built-in thermal overload with automatic reset.

Further protections are not required.

BIOX® range three phase pumps can be protected by using a magneto-thermic motor protector or a contactor with thermal relay; in both cases they have to be rated conforming to nominal power showed on motor plate.

Eventual electric float switch must be connected to auxiliary connector buckles.

Rotation direction testing three phase pumps

Water head and delivery are terribly effected by wrong rotation of shaft of pump motor.

Clock wise rotation is correct (upside view of pump).

When startin the pump motor will ungergo an anti-clock wise back-kick.

In this case test is positive; on contrary case, please disconnect pump from network and inverse two phases.

CONNECTIONS DIAGRAM:

- A) Single phase manual pump
- B) Single phase automatic pump
- C) Three phase pump

See diagrams Pict.2

See Pict. 2

1) START (green)	5) SUPPLY CORD	9) WHITE
2) RUN (red)	6) GROMMET	10) LIGHT BLUE < LINE >
3) COMMON (black)	7) PLUG	11) BROWN < LINE >
4) CAPACITOR	8) YELLOW-GREEN	12) FLOAT SWITCH

CHAP. 5 MAINTENANCE AND TROUBLE SHOOTING



DANGER
Electric shock risk

Before doing any operation, make sure pump is disconnected from electric current network.



DANGER
Electric shock risk

Power cord must be replaced by manufacturer or by Customer service, using special tools.

No maintenance is required when BIOX® range pumps operate in normal conditions.

Occasionally maintenance of liquid ends and replacement of impeller may be required.

FAULT	POSSIBLE CAUSE	REMEDY
PUMP DOES NOT DELIVER, MOTOR DOES NOT RUN.	1) No electric current supplying. 2) Incorrect plugging in . 3) Circuit-breaker come into operation. 4) Impeller blocked. 5) Motor or capacitor damaged.	2) Verify presence of electric current supply and plug in. 3) Reinforce circuit-breaker. Please call electrician in case circuit-breaker comes again into operation. 4) Remove obstacle. 5) Call dealer.
PUMP DOES NOT DELIVER, MOTOR RUNS.	1) Filter obstructed. 2) Non return valve blocked.	1) Clean filter. 2) Clean or replace valve.
PUMP DELIVERS REDUCED WATER	1) Filter partially obstructed . 2) Delivery pipe partially obstructed. 3) Impeller worn off. 4) Anticlockwise rotation (three phase version).	1) Clean filter. 2) Remove obstacles. 3) Replace impeller. 4) Inverse two phases.
INTERMITTENT WORKING (SINGLE PHASE VERSION)	1) Solids obstruct impeller. 2) Too warm liquid. 3) Motor broken.	1) Remove obstacles. 3) Call dealer.